

mark®

CONTROL BOX / WAHLSCHALTER / BOÎTIER DE RACCORDEMENT / DOORLUSKAST


0664020

Assembly Instruction **EN**


Montageanleitung **DE**

Manuel de Montage **FR**

Montage instructie **NL**

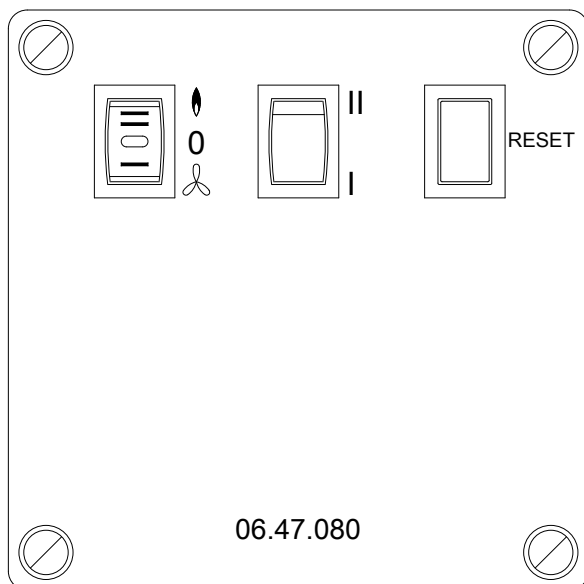


General information
Allgemeine information
Renseignements générale
Algemene informatie

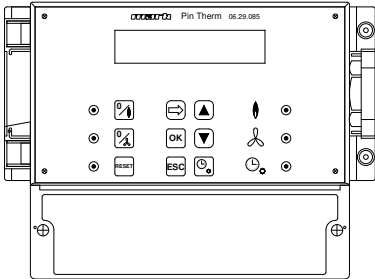

- See the supplied assembly and operating manual for information on the Mark Pintherm.
- Informationen zum Mark PinTherm siehe in der mitgelieferten Montage- und Bedienungsanleitung.
- Pour de plus amples informations concernant le Mark PinTherm, consultez la notice de montage et le manuel d'utilisation.
- Voor informatie over de Mark PinTherm zie de meegeleverde montage en bedieningshandleiding bij de PinTherm.

- Maximum number of units to be connected:
- Maximal anschließbare Geräte:
- Nombre maximal d'appareils à brancher:
- Maximaal aantal units aan te sluiten:

G(N)SE	INFRA	INFRA-LINE
6	12	6

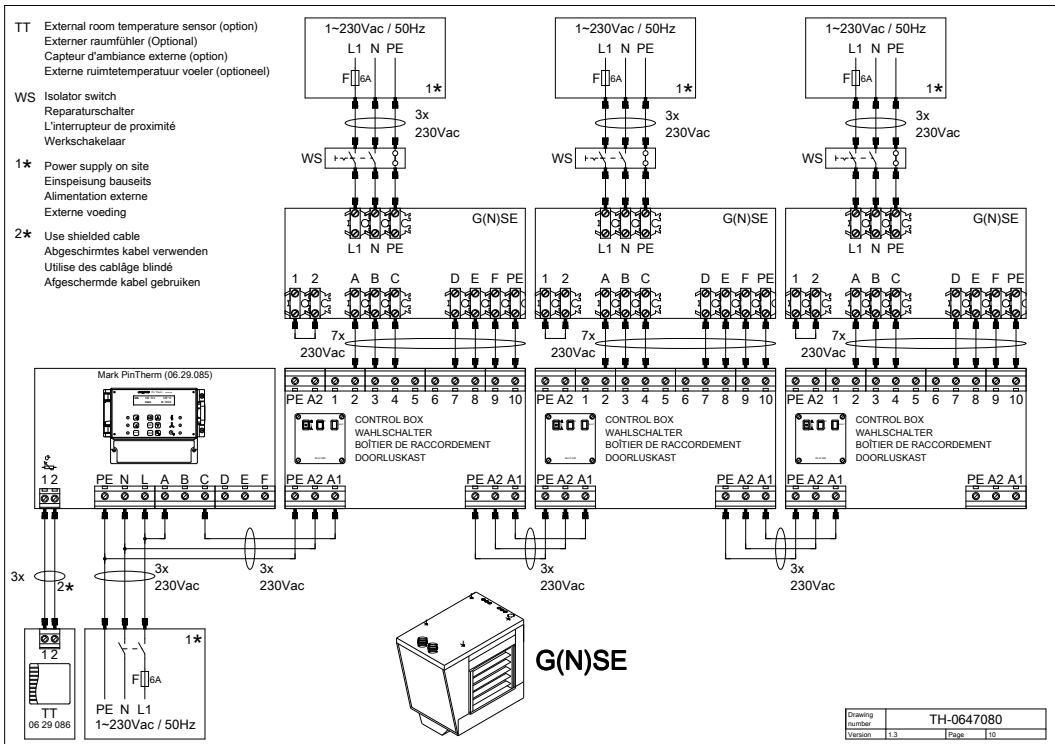


TT External black bulb sensor (option)
 Externer Strahlungsfühler (Optional)
 Capteur globe noir externe (option)
 Externe zwarte bol voeler (optioneel)

WS Isolator switch (Optional)
 Reparaturschalter (optional)
 L'interupteur de proximité (option)
 Werkshakelaar (optioneel)

1* Power supply on site
 Einspeisung bausets
 Alimentation externe
 Externe voeding

2* Use shielded cable
 Abgeschirmtes kabel verwenden
 Utilise des câblage blindé
 Afgeschermde kabel gebruiken

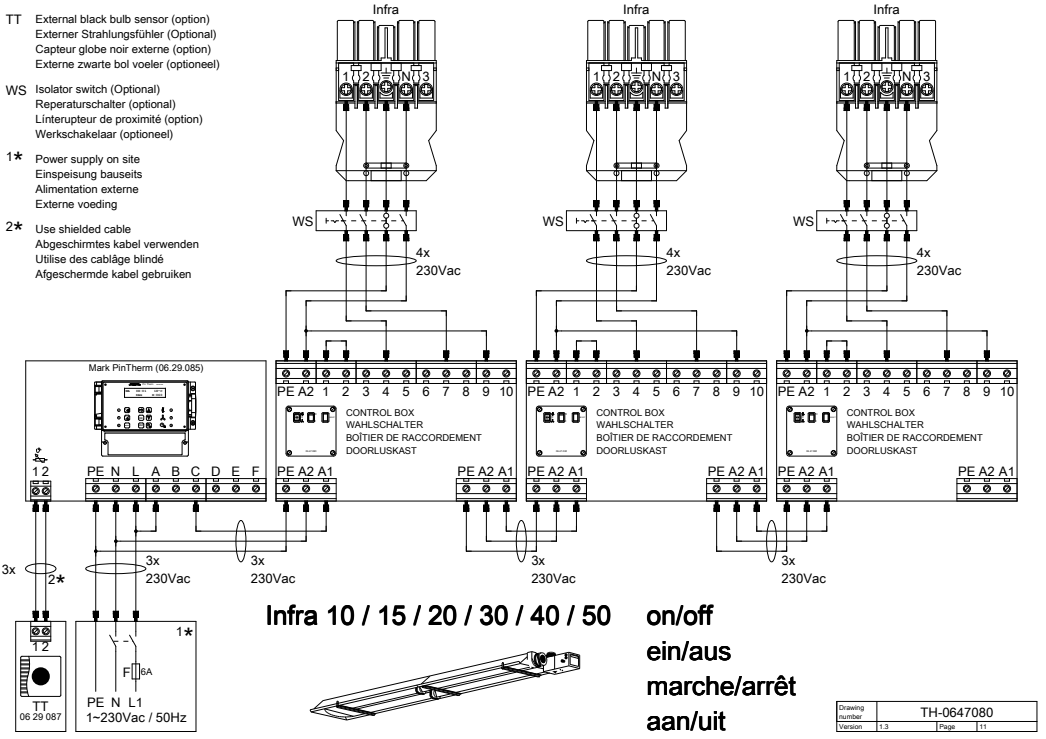

TT External black bulb sensor (option)
 Externer Strahlungsfühler (Optional)
 Capteur globe noir externe (option)
 Externe zwarte bol voeler (optioneel)

WS Isolator switch (Optional)
 Reparaturschalter (optional)
 L'interupteur de proximité (option)
 Werkshakelaar (optioneel)

1* Power supply on site
 Einspeisung bausets
 Alimentation externe
 Externe voeding

2* Use shielded cable
 Abgeschirmtes kabel verwenden
 Utilise des câblage blindé
 Afgeschermde kabel gebruiken

