




Connection with isolator switch

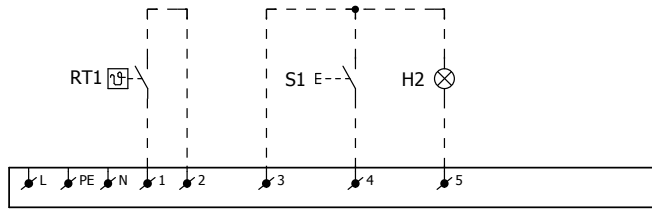


Power supply



External connections

- | BM - Burner fan
- | F1,F2 - Fuse
- | H1,H2 - Alarm light
- | H3 - On
- | IS - Ionization bar
- | K3 - Auxillary relay
- | LD2 - Pressure switch
- | OT - Ignition transformer
- | Q1 - Motor relay
- | RT - Room thermostat
- | S1 - Reset button
- | TR - Transformer
- | TR1,2 - Time relay
- | VA1/VA2 - Gasvalve
- | WS - Isolator switch
- | Z1 - Netfilter

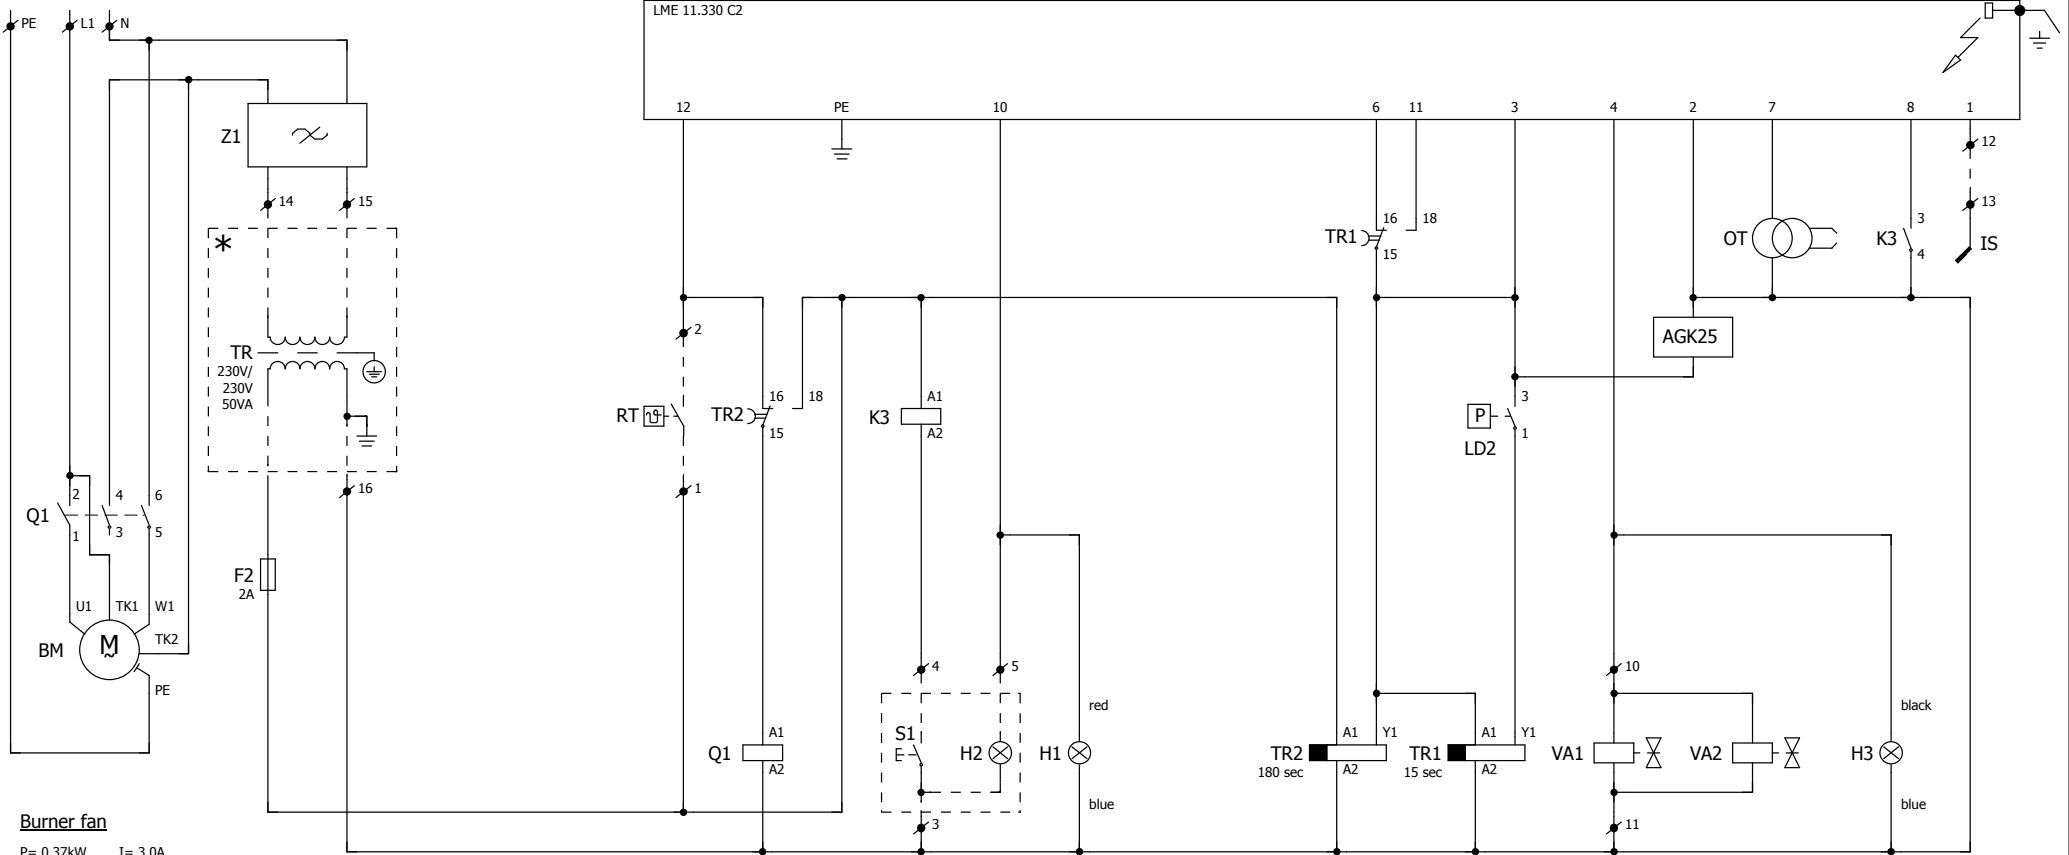

Burner fan

P= 0.37kW I= 3.0A

\* For heaters with transformer

Infra-Line on/off

Electrical drawing

Get.	S.N.	Date	30-9-2010
Gec.		Norm	

Drawing number

Group	IL	Type	Infra-Line
Art.nr.	30.03.192	Version	1.3

IL-001000-EN